



Operating instructions

Pressure relief device. CEDASPE® VST2 080

10707531/00 EN



© All rights reserved by Maschinenfabrik Reinhausen

Dissemination and reproduction of this document and use and disclosure of its content are strictly prohibited unless expressly permitted.

Infringements will result in liability for compensation. All rights reserved in the event of the granting of patents, utility models or designs.

The product may have been altered since this document was published.

We reserve the right to change the technical data, design and scope of supply.

Generally the information provided and agreements made when processing the individual quotations and orders are binding.

The product is delivered in accordance with MR's technical specifications, which are based on information provided by the customer. The customer has a duty of care to ensure the compatibility of the specified product with the customer's planned scope of application.

The original operating instructions were written in German.

Table of contents

1	Introduction	5
1.1	Manufacturer	5
1.2	Safekeeping	5
1.3	Notation conventions	5
1.3.1	Hazard communication system	5
1.3.2	Information system	7
1.3.3	Instruction system	7
1.3.4	Typographic conventions	8
2	Security	9
2.1	Intended use	9
2.2	Fundamental safety instructions	10
2.3	Personnel qualification	12
2.4	Personal protective equipment	13
3	Product description	14
3.1	Scope of delivery	14
3.2	Function description	14
3.3	Design	15
3.4	Nameplate	16
4	Packaging, transport and storage	17
4.1	Purpose	17
4.2	Suitability, structure and production	17
4.3	Markings	17
4.4	Transportation, receipt and handling of shipments	18
4.5	Storage of shipments	19
5	Mounting	20
5.1	Checking the pipe flanges	21
5.2	Mounting the device	23
5.3	Electrical connection	25
5.3.1	Cable recommendation	26
5.3.2	Connection via connection box	26

6	Commissioning	28
6.1	Filling with oil and performing the venting test	28
6.2	Leak test.....	29
6.3	Checking the function of the micro-switches	29
7	Operation.....	30
7.1	Contact signals	30
7.2	Pressure relief device operating state.....	31
7.3	Manually resetting the micro-switches.....	32
8	Maintenance and inspection	33
9	Fault elimination	34
9.1	Testing the tripping circuit and reason for tripping	34
10	Disposal	35
10.1	SVHC information in accordance with the REACH regulation	35
11	Technical data.....	36
12	Drawings.....	39
12.1	VST2 080	40
	Glossary	41

1 Introduction

This technical file contains detailed descriptions on the safe and proper installation, connection, commissioning and monitoring of the product.

This technical document is intended solely for specially trained and authorized personnel.

1.1 Manufacturer

CEDASPE S.r.l.
Via Colombara 1
20098 S. Giuliano Milanese (MI)
Italy

Tel.: +39 029 820 4411
Internet: www.reinhausen.com

Further information on the product and copies of this technical file are available from this address if required.

1.2 Safekeeping

Keep this technical file and all supporting documents ready at hand and accessible for future use at all times.

1.3 Notation conventions

This section contains an overview of the symbols and textual emphasis used.

1.3.1 Hazard communication system

Warnings in this technical file are displayed as follows.

1.3.1.1 Warning relating to section

Warnings relating to sections refer to entire chapters or sections, sub-sections or several paragraphs within this technical document. Warnings relating to sections have the following format:

▲ WARNING



Type of danger!

Source of the danger and its consequences.

- > Action
- > Action

1.3.1.2 Embedded warning information

Embedded warnings refer to a particular part within a section. These warnings apply to smaller units of information than the warnings relating to sections. Embedded warnings use the following format:

▲ DANGER! Instruction for avoiding a dangerous situation.

1.3.1.3 Signal words

Depending on the product, the following signal words are used:

Signal word	Meaning
DANGER	Indicates a hazardous situation which, if not avoided, will result in death or serious injury.
WARNING	Indicates a hazardous situation which, if not avoided, could result in death or serious injury.
CAUTION	Indicates a hazardous situation which, if not avoided, could result in minor or moderate injury.
NOTICE	Indicates measures to be taken to prevent damage to property.

Table 1: Signal words in warning notices

1.3.2 Information system

Information is designed to simplify and improve understanding of particular procedures. In this technical file it is laid out as follows:



Important information.

1.3.3 Instruction system

This technical file contains single-step and multi-step instructions.

Single-step instructions

Instructions which consist of only a single process step are structured as follows:

Aim of action

✓ Requirements (optional).

1. Step 1 of 1.

» Result of step (optional).

» Result of action (optional).

Multi-step instructions

Instructions which consist of several process steps are structured as follows:

Aim of action

✓ Requirements (optional).

1. Step 1.

» Result of step (optional).

2. Step 2.

» Result of step (optional).

» Result of action (optional).

1.3.4 Typographic conventions

Typographic convention	Purpose	Example
UPPERCASE	Operating controls, switches	ON/OFF
[Brackets]	PC keyboard	[Ctrl] + [Alt]
Bold	Software operating controls	Press Continue button
...>...>...	Menu paths	Parameter > Control parameter
<i>Italics</i>	System messages, error messages, signals	<i>Function monitoring alarm triggered</i>
[▶ Number of pages]	Cross reference	[▶ Page 41].
<u>Dotted underscore</u>	Glossary entry, abbreviations, definitions, etc.	<u>Glossary entry</u>

Table 2: Typographic conventions used in this technical file

2 Security

Read this technical file through carefully to familiarize yourself with the product. This technical file is a part of the product.

- Read and observe the safety instructions provided in this chapter in particular.
- Observe the warnings in this technical file to avoid function-related dangers.

The product is manufactured based on state-of-the-art technology. Nevertheless, danger to life and limb for the user or impairment of the product and other material assets may arise in the event of improper use.

2.1 Intended use

The pressure relief device protects oil-filled power transformers and on-load tap-changers against impermissible pressure increases. At a predetermined pressure, the pressure relief device opens, relieves the pressure and closes tightly again once the pressure has dropped.

The product is designed solely for use in transport systems for transporting people or goods or for use in stationary large-scale systems.

If used as intended and in compliance with the requirements and conditions specified in this technical file as well as the warning notices in this technical file and attached to the product, then the product does not present any danger to people, property or the environment. This applies throughout the service life of the product, from delivery, installation and operation to removal and disposal.

The following is considered intended use:

- Only use the product for oil-filled power transformers.
- Operate the product in accordance with this technical documentation, the agreed-upon delivery conditions and the technical data.
- Ensure that all necessary work is performed by qualified personnel only.
- Use the equipment and special tools supplied solely for the intended purpose and in accordance with the specifications of this technical file.

2.2 Fundamental safety instructions

To prevent accidents, malfunctions and damage as well as unacceptable adverse effects on the environment, those responsible for transport, installation, operation, maintenance and disposal of the product or parts of the product must ensure the following:

Personal protective equipment

Loosely worn or unsuitable clothing increases the danger of becoming trapped or caught up in rotating parts and the danger of getting caught on protruding parts. This results in danger to life and limb.

- All necessary devices and personal protective equipment required for the specific task, such as a hard hat, safety footwear, etc. must be worn. Observe the "Personal protective equipment" [► Section 2.4, Page 13] section.
- Never wear damaged personal protective equipment.
- Never wear rings, necklaces or other jewelry.
- If you have long hair, wear a hairnet.

Work area

Untidy and poorly lit work areas can lead to accidents.

- Keep the work area clean and tidy.
- Make sure that the work area is well lit.
- Observe the applicable laws for accident prevention in the relevant country.

Explosion protection

Highly flammable or explosive gases, vapors and dusts can cause serious explosions and fire.

- Do not install or operate the product in areas where a risk of explosion is present.

Safety markings

Warning signs and safety information plates are safety markings on the product. They are an important aspect of the safety concept. Safety markings are depicted and described in the chapter "Product description".

- Observe all safety markings on the product.
- Make sure all safety markings on the product remain intact and legible.
- Replace safety markings that are damaged or missing.

Ambient conditions

To ensure reliable and safe operation, the product must only be operated under the ambient conditions specified in the technical data.

- Observe the specified operating conditions and requirements for the installation location.

Modifications and conversions

Unauthorized or inappropriate changes to the product may lead to personal injury, material damage and operational faults.

- Only modify the product after consultation with Maschinenfabrik Reinhausen GmbH.

Spare parts

Spare parts not approved by Maschinenfabrik Reinhausen GmbH may lead to physical injury, damage to the product and malfunctions.

- Only use spare parts that have been approved by Maschinenfabrik Reinhausen GmbH.
- Contact Maschinenfabrik Reinhausen GmbH.

Working during operation

You must only operate the product when it is in a sound operational condition. Otherwise it poses a danger to life and limb.

- Regularly check the operational reliability of safety equipment.
- Perform the inspection tasks described in this technical document regularly.

2.3 Personnel qualification

The person responsible for assembly, commissioning, operation and inspection must ensure that personnel are sufficiently qualified.

Electrically skilled person

The electrically skilled person has a technical qualification and therefore has the required knowledge and experience, and is also conversant with the applicable standards and regulations. The electrically skilled person is also proficient in the following:

- Can identify potential dangers independently and is able to avoid them.
- Is able to perform work on electrical systems.
- Is specially trained for the working environment in which (s)he works.
- Must satisfy the requirements of the applicable statutory regulations for accident prevention.

Electrically trained persons

An electrically trained person receives instruction and guidance from an electrically skilled person in relation to the tasks undertaken and the potential dangers in the event of inappropriate handling as well as the protective devices and safety measures. The electrically trained person works exclusively under the guidance and supervision of an electrically skilled person.

Operator

The operator uses and operates the product in line with this technical file. The operating company provides the operator with instruction and training on the specific tasks and the associated dangers arising from improper handling.

Technical Service

We strongly recommend having repairs and retrofitting carried out by our Technical Service department. This ensures that all work is performed correctly. If a repair is not carried out by our Technical Service department, please ensure that the personnel who carry out the maintenance are trained and authorized by CEDASPE S.r.l. to carry out the work.

CEDASPE S.r.l

Via Colombara 1
20098 S. Giuliano Milanese (MI)
Italy

Tel.: +39 029 820 4411

Internet: www.reinhausen.com

2.4 Personal protective equipment

Personal protective equipment must be worn during work to minimize risks to health.

- Always wear the personal protective equipment required for the job at hand.
- Never wear damaged personal protective equipment.
- Observe information about personal protective equipment provided in the work area.

Protective clothing	Close-fitting work clothing with a low tearing strength, with tight sleeves and with no protruding parts. It mainly serves to protect the wearer against being caught by moving machine parts.
Safety shoes	To protect against falling heavy objects and slipping on slippery surfaces.
Safety glasses	To protect the eyes from flying parts and splashing liquids.
Visor	To protect the face from flying parts and splashing liquids or other dangerous substances.
Hard hat	To protect against falling and flying parts and materials.
Hearing protection	To protect against hearing damage.
Protective gloves	To protect against mechanical, thermal and electrical hazards.

Table 3: Personal protective equipment

3 Product description

3.1 Scope of delivery

The following items are included in the scope of delivery:

- Pressure relief device
- O-ring gasket for assembly
- O-ring gasket for connection to the oil escape opening

3.2 Function description

The pressure relief device with the device flange is mounted tightly on the top or on the side of transformer tank or on the on-load tap-changer. If the internal pressure of the transformer or the on-load tap-changer exceeds the predefined operating pressure of the pressure relief device, then the spring-loaded valve plate lifts off of its seal seat within a few milliseconds. As a result, the internal pressure is relieved as quickly as possible and the valve plate again closes the pressure relief device tightly.

As an external indication that the valve has tripped, a self-locking signal pin slides out of the housing.

Once the pressure falls below the operating pressure, the valve closes again. The signal pin must be reset to its operating position manually. The signaling contacts installed as an option are automatically reset in the process.

If the device trips (ALARM state), a signal is sent optionally via up to 4 micro-switches (change-over contacts). The micro-switches are connected to the electrical controller and the monitoring circuit of the transformer.

3.3 Design

The device is mounted via a 4-hole flange. The device is equipped with a protective cover with integrated terminal box. The protective cover has a square 4-hole connection for a pipe ($\varnothing 70$ mm) so that escaping oil can be drained away cleanly. The red signal pin indicates that the device has tripped. As an option, the Crouzet device version (type K) can be equipped with a maximum of 4 micro-switches (change-over contact) that are connected electrically via the terminal strip in the terminal box.

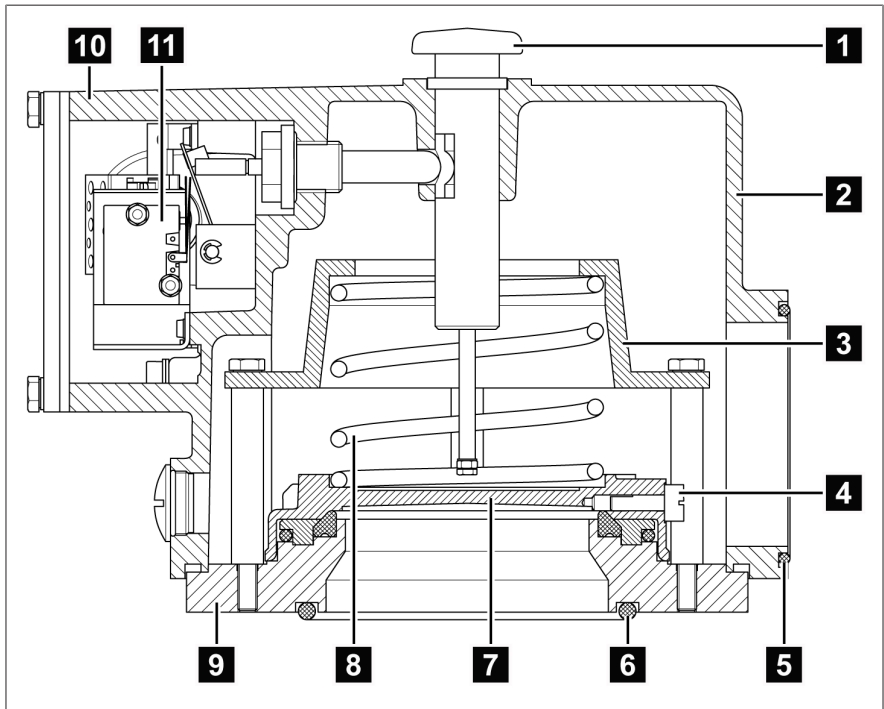


Figure 1: Design

1	Signal pin	2	Protective cover with connection for pipe for directed oil flow
3	Counter bearing for spring assembly	4	Vent screw
5	O-ring gasket for connecting the pipe for directed oil flow	6	O-ring gasket

7	Valve plate	8	Spring assembly
9	Device flange	10	Terminal box
11	Micro-switch (optional)		

3.4 Nameplate

The nameplate is on the device upper side.

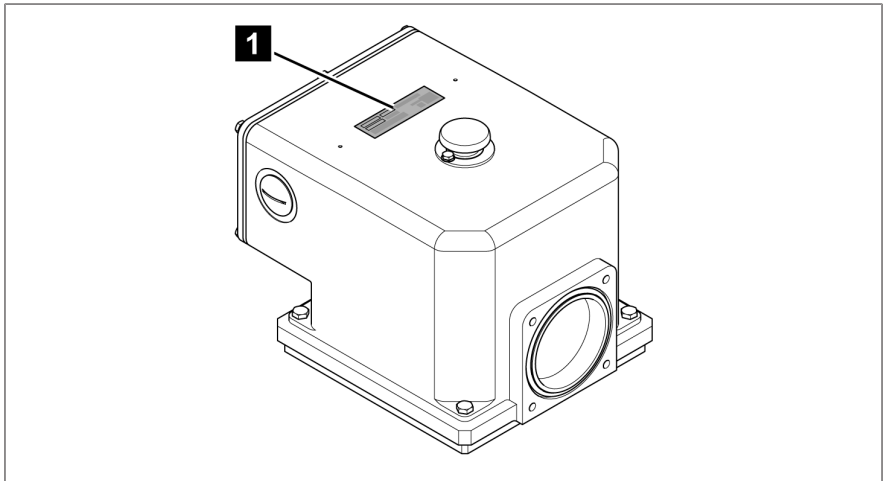


Figure 2: Nameplate

1	Nameplate		
---	-----------	--	--

4 Packaging, transport and storage

4.1 Purpose

The packaging is designed to protect the packaged product during transport, loading, unloading and during periods of storage in such a way that no detrimental changes occur. The packaging must protect the goods against permitted transport stresses such as vibration and knocks.

The packaging also prevents the packaged goods from moving impermissibly within the packaging.

4.2 Suitability, structure and production

The goods are packaged in a sturdy cardboard box. This ensures that the shipment is held securely in the intended transport position.

Inlays inside the box stabilize the goods, preventing impermissible changes of position, and protect them from vibration.

4.3 Markings

The packaging bears a signature with instructions for safe transport and correct storage. The following symbols apply to the shipment of non-hazardous goods. Adherence to these symbols is mandatory.




 <p>Protect against moisture</p>	 <p>Top</p>	 <p>Fragile</p>
---	--	--

Table 4: Shipping pictograms

4.4 Transportation, receipt and handling of shipments

In addition to vibrations, jolts must also be expected during transportation. In order to prevent possible damage, avoid dropping, tipping, knocking over and colliding with the product.

If the packaging tips over or falls, damage is to be expected regardless of the weight.

Every delivered shipment must be checked for the following by the recipient before acceptance (acknowledgment of receipt):

- Completeness based on the delivery slip
- External damage of any type.

The checks must take place after unloading when the cartons or transport container can be accessed from all sides.

Visible damage

If external transport damage is found upon receipt of the shipment, proceed as follows:

- Immediately record the transport damage found in the shipping documents and have this countersigned by the carrier.
- In the event of severe damage, total loss or high damage costs, immediately notify CEDASPE S.r.l and the relevant insurance company.
- After identifying damage, do not modify the condition of the shipment further and retain the packaging material until an inspection decision has been made by the transport company or the insurance company.
- Record the details of the damage immediately on site together with the carrier involved. This is essential for any claim for damages.
- If possible, photograph damage to packaging and packaged goods. This also applies to signs of corrosion on the packaged goods due to moisture inside the packaging (rain, snow, condensation).
- Be absolutely sure to also check the sealed packaging.

Hidden damage

When damage is not determined until unpacking after receipt of the shipment (hidden damage), proceed as follows:

- Make the party responsible for the damage liable as soon as possible by telephone and in writing, and prepare a damage report.
- Observe the time periods applicable to such actions in the respective country. Inquire about these in good time.

With hidden damage, it is very hard to make the transportation company (or other responsible party) liable. Any insurance claims for such damage can only be successful if relevant provisions are expressly included in the insurance terms and conditions.

4.5 Storage of shipments

When selecting and setting up the storage location, ensure the following:

- Store the product and accessories in the original packaging until installation.
- Protect stored goods against moisture (rain, flooding, water from melting snow and ice), dirt, pests such as rats, mice, termites etc. and against unauthorized access.
- Store crates and boxes on pallets, timber beams or planks as protection against ground moisture and for improved ventilation.
- Ensure that the foundation has sufficient load-bearing capacity.
- Keep entrance paths clear.
- Check the stored goods at regular intervals. Also take appropriate action after storms, heavy rain or snow etc.

5 Mounting

This chapter describes how to correctly mount and connect the device.

The pressure relief device is mounted on a device flange on the transformer or on-load tap-changer.

Note the connection diagrams provided.

DANGER



Electric shock!

Risk of fatal injury due to electrical voltage. Always observe the following safety regulations when working in or on electrical equipment.

- > Disconnect the equipment.
- > Lock the equipment to prevent an unintentional restart.
- > Make sure all poles are de-energized.
- > Ground and short-circuit.
- > Cover or cordon off adjacent energized parts.

WARNING



Risk of injury

Danger of serious injury due to springs that are under high tension.

- > Never unscrew the fixing screws of the counter bearing.

NOTICE

Property damage!

The function of the device will be impaired due to drying. As a result, the transformer will no longer be protected against impermissible pressure increases.

- > Ensure that the device is not dried in the oven.
- > Only mount the device once the transformer / on-load tap-changer has been dried.

⚠ CAUTION



Risk of injury and damage to property!

Escaping hot oil and gas can lead to injuries and damage to the device. Direct escaping hot oil and gas away from people and critical transformer parts.

The pressure relief device can be mounted horizontally or vertically, as close as possible to potential error sources.

When installed vertically the connection opening of the protective cover must face downwards to ensure complete drainage of the oil in the event of tripping.

When installed vertically or at a slight angle, the vent screw must face upwards or be at the highest point on the device to ensure proper venting.

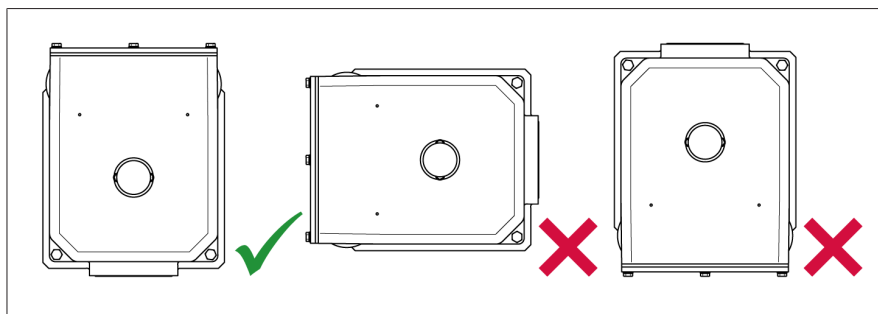


Figure 3: Possible mounting positions

There must be a minimum clearance above or in front of the device so that the signal pin can be pushed fully out of the housing. Refer to the drawings in the appendix for the minimum clearance necessary.

5.1 Checking the pipe flanges

The pipe flanges must be flush and clean to allow the device to be positioned with the least possible stress.

NOTICE! A residual distance between the flanges caused by a deviation in evenness can cause damage to the flanges. Even slight unevenness can cause the flange of the device to be curved too much, leading to cracks in the flange caused by the resulting transverse stress.

Therefore, check the following:

- Pipe flanges
 - Flush and even
 - Evenness deviation ≤ 0.2 mm

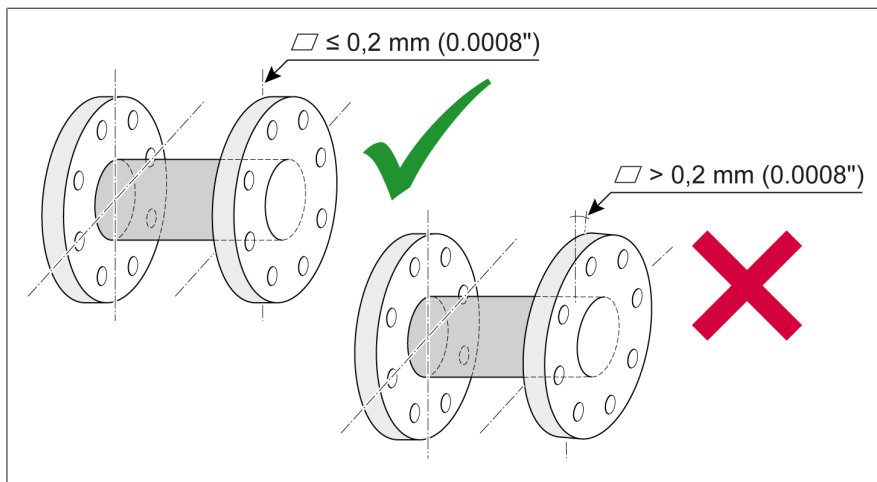


Figure 4: Flanges

- Pipe flange sealing surfaces
 - Clean and undamaged
 - Without any damage along the radial surface such as scratches, dents or points of impact
 - The surface quality of the sealing surface must be suitable for the gasket being used
- Installation material (screws, nuts, washers)
 - Clean and undamaged, particularly the threads and contact surfaces

5.2 Mounting the device

You must first remove the protective cover to mount the device. After mounting, reattach the protective cover to the device.

Removing the protective cover

1. Unscrew and remove the fixing screws on the protective cover.

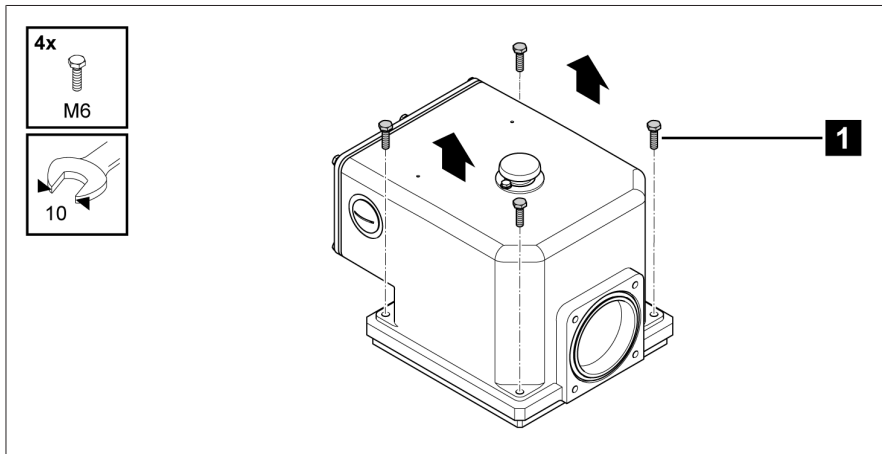


Figure 5: Unscrewing the protective cover fixing screws

1	4 x M6 fixing screws		
---	----------------------	--	--

2. Lift off the protective cover and place it on a stable surface.

Mounting the device

Refer to the Drawings chapter for dimensions and connection data.

1. Insert the o-ring gasket included in the delivery underneath the device in the groove intended for this. **NOTICE!** Malfunction! An incorrectly seated o-ring gasket can result in leaks. When mounting, ensure that the o-ring gasket is seated correctly in the groove intended for this.
2. Place the device onto suitable fixing bolts (4 x M16 fixing bolts, wrench size 24) and mount it onto the counter flange of the transformer/on-load tap-changer via the holes in the device flange using suitable nuts and washers.
3. Tighten the nuts crosswise with 10% of the max. tightening torque.
4. Tighten the nuts crosswise with 30% of the max. tightening torque.

5. Tighten the nuts crosswise with 60% of the max. tightening torque.
6. **NOTICE!** Damage to the holes due to a tightening torque that is too high. Tighten the nuts crosswise with 100% of the tightening torque and continue to retighten the nuts with 100% of the tightening torque until the screws can no longer be turned further.

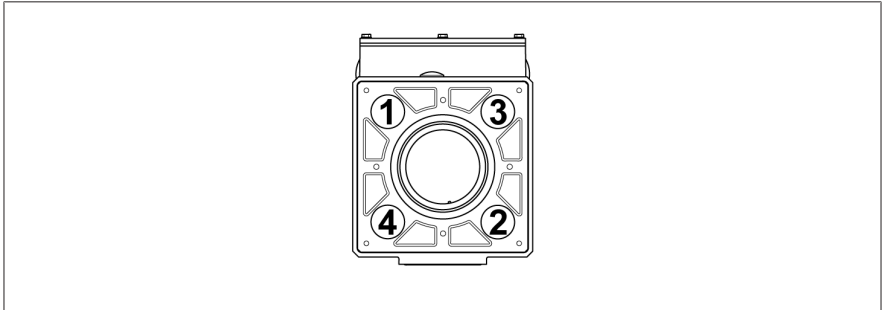


Figure 6: Tightening the screws crosswise

Mounting the protective cover

1. Insert the protective cover fixing screws into the intended holes and turn the protective cover gently around its axis until the screws engage in the threads in the protective cover.
2. **NOTICE!** Damage to the o-ring gasket. Protect the o-ring gasket between the device and the counter flange and, during all intermediate steps, only position the device lightly and do not press it down.
3. **NOTICE!** Do not tilt or jam the protective cover! Tighten the fixing screws slightly crosswise several times to prevent the protective cover from tilting or jamming while it is being lowered.

4. Then tighten the fixing screws crosswise up to the maximum tightening torque.

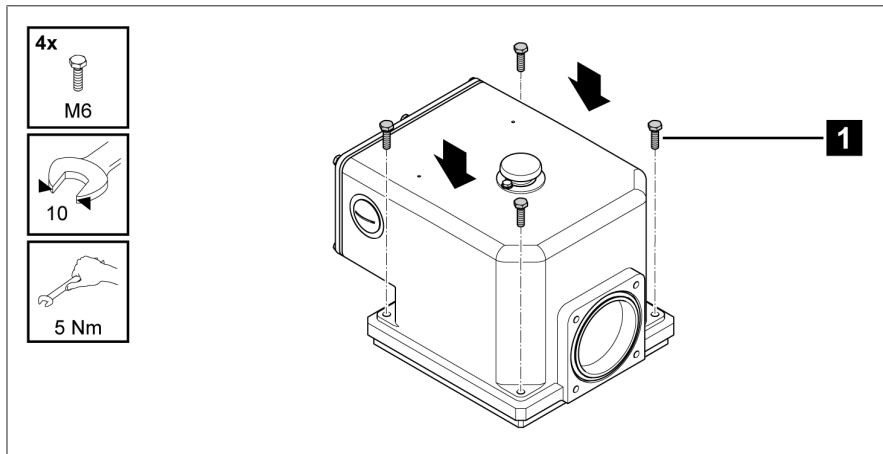


Figure 7: Mounting the protective cover

1	4 x M6 fixing screws		
---	----------------------	--	--

Mounting the oil drainage unit

1. Remove the plastic cap from the oil escape opening.
2. Insert the o-ring gasket included in the delivery into the 4-hole connection.
3. Mount the pipe of the oil drainage unit onto the 4-hole connection via the drill holes using suitable M6x12 screws and washers.
4. Tighten the screws crosswise.

5.3 Electrical connection

⚠ DANGER



Electric shock!

Risk of fatal injury due to electrical voltage when connecting the device.

- Ensure that all cables are free of voltage during connection work.

⚠ WARNING



Danger of death or severe injury!

Danger of death or severe injury due to improper electrical connection of the pressure relief device.

- When the pressure relief device trips, the transformer must be immediately de-energized by the circuit breaker.
- Ensure that the pressure relief device's signaling contact is correctly looped into the tripping circuit of the transformer circuit breaker.

Connecting the micro-switches (optional)

The Crouzet device version (type K) can be equipped with a maximum of 4 micro-switches (change-over contact) that are connected electrically via the terminal strip in the terminal box.

5.3.1 Cable recommendation

Please note the following recommendation when wiring the device:

- To make the connection, you need suitable cables, ring cable lugs and cable glands that are not included in the scope of delivery.
- The cables used must be flame-resistant in accordance with IEC 60332-1-2 or UL 2556 VW-1.

Cable	Conductor cross-section	Connection
Signal lines	4 mm ²	M3 screw
Protective conductor	≥ all other conductors	M5 screw

Table 5: Cable recommendation

5.3.2 Connection via connection box

1. Unscrew the screws on the terminal box and remove the cover (6 x M5, open-end wrench, wrench size 8).
2. Mount an M25 x 1.5 cable gland in the terminal box.
3. **NOTICE!** To ensure the IP degree of protection of the device, use a suitable cable gland with at least IP65.

4. Unscrew the screws on the terminal strip (3, 6, 9 or 12 x M3, bladed screw-driver).
5. Remove an amount of sheathing from the double-insulated cable appropriate for the wiring, strip off 7 mm of insulation from the individual wires and cap off with ferrules.
6. **NOTICE!** Do not kink the wires! Connect the signal lines and protective conductor to the labeled terminal strip in loose arcs in accordance with the wiring diagram.
7. **NOTICE!** To prevent damage, observe the specified tightening torques.
8. Guide the cable through the cable gland and connect it to the terminals in accordance with the wiring diagram. The wiring diagram can be found on the inside of the terminal box cover.

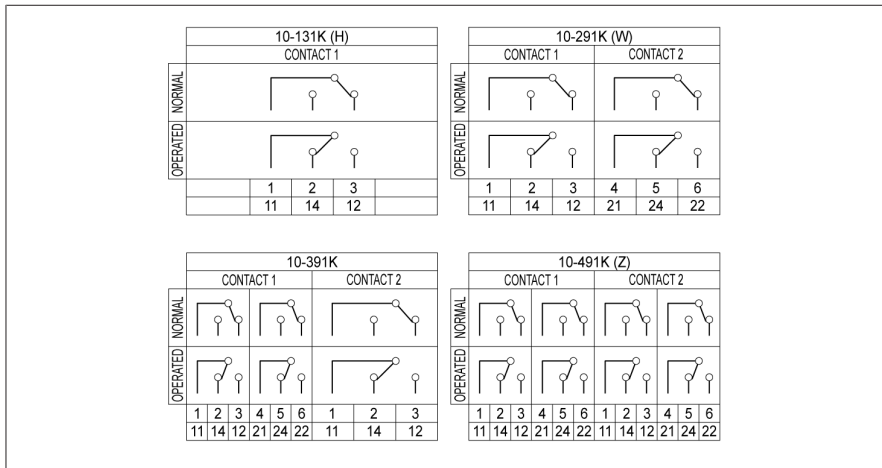


Figure 8: Wiring diagrams

9. Tighten the screws on the terminal strip (M3, bladed screwdriver, 0.6 Nm).
10. Ground the device via a grounding cable with ring cable lug. To do so, loosen the grounding screw (M5, 4 mm Allen key).
11. Place the ring cable lug on the grounding screw between the two washers (M5) and tighten the grounding screw (4 mm Allen key, 3 Nm).
12. Position the cover on the terminal box and tighten the screws.

6 Commissioning

Prior to commissioning the transformer, perform the following checks. If anything is unclear regarding the checks or troubleshooting, please contact CEDASPE S.r.l [► Section 1.1, Page 5].

6.1 Filling with oil and performing the venting test

▲ WARNING



Danger of explosion and danger of poisoning!

Explosive gases in the device can deflagrate or explode and result in severe injury or death. Inhaling the gases released can lead to poisoning or suffocation.

- Ensure that there are no ignition sources such as open flames, hot surfaces or sparks (e.g. caused by the build-up of static charge, electrical devices) in the immediate surroundings and that none occur.
- Do not inhale any gas released.



When installed vertically or at a slight angle, the vent screw must face upwards or be at the highest point on the device to ensure proper venting.

- ✓ The transformer tank is filled with insulating fluid.
- ✓ The conservator is filled with insulating fluid.
- ✓ The device is mounted on the top or the side of the transformer tank.
 1. Remove the protective cover (see Mounting the device [► Section 5.2, Page 23]) and place it on a stable surface.
 2. Loosen the vent screw (bladed screwdriver) without unscrewing it completely until air audibly flows out of the device and insulating fluid escapes.
 3. Tighten the vent screw with a maximum tightening torque of 0.5 Nm.
 4. Use a cloth to remove the insulating fluid from the surface of the device.
 5. Mount the protective cover on the device (see Mounting the device [► Section 5.2, Page 23]).
- » The device is filled with oil and vented.

6.2 Leak test

- ✓ The device is filled with insulating fluid.
- 1. Check the tightness of the flange connection.
- 2. If the connection is not tight, check the gasket and replace it if necessary.
 - » The test is complete.

6.3 Checking the function of the micro-switches

- ✓ The cover of the terminal box has been removed.
- ✓ Normal operating conditions have been checked and are in accordance with the wiring diagram.
- 1. Connect a multimeter to the terminals in the open state.
- 2. Pull the signal pin upward to actuate the contact.
 - » The multimeter receives a signal.
- 3. Push the signal pin into the device to reinstate normal operating conditions.
 - » The test is complete.

7 Operation

7.1 Contact signals





Normal operating conditions	Alarm contact description	Note
<p>Wiring diagram 10-131K (H)</p> 	<p>Switches 1-2/11-14 closed.</p>	<p>When the predetermined pressure is exceeded, the device trips, relieves the pressure and closes tightly again once the pressure has dropped.</p>
<p>Wiring diagram 10-291K (W)</p> 	<p>Switches 1-2/11-14 and switches 4-5/21-24 closed.</p>	<p>When the predetermined pressure is exceeded, the device trips, relieves the pressure and closes tightly again once the pressure has dropped.</p>
<p>Wiring diagram 10-391K</p> 	<p>Switches 1-2/11-14 and switches 4-5/21-24 closed.</p>	<p>When the predetermined pressure is exceeded, the device trips, relieves the pressure and closes tightly again once the pressure has dropped.</p>
<p>Wiring diagram 10-491K (Z)</p> 	<p>Switches 1-2/11-14 and switches 4-5/21-24 closed.</p>	<p>When the predetermined pressure is exceeded, the device trips, relieves the pressure and closes tightly again once the pressure has dropped.</p>

Table 6: Contact signals

7.2 Pressure relief device operating state

The operating state of the pressure relief device is shown from the outside by the position of the signal pin:

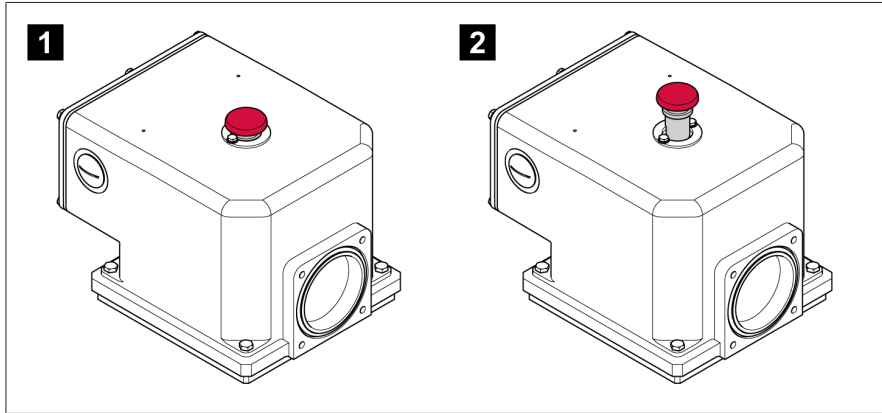


Figure 9: Operating positions of the signal pin

1 Operation	2 ALARM – Pressure relief device has tripped
-------------	--

If the pressure relief device has tripped, the signal pin remains in the ALARM position, even after the pressure in the transformer/on-load tap-changer has normalized again. If the micro-switches inside the housing are connected, a signal is transmitted to the control room at the same time.

> After eliminating the cause, press the signal pin back down manually.

If the signal pin is in the Operation position, the pressure relief device has not tripped mechanically. If a micro-switch has nonetheless issued a signal, the fault may lie in the tripping circuit, see chapter Checking the tripping circuit and tripping reason [► Section 9.1, Page 34].

7.3 Manually resetting the micro-switches

If the device is equipped with the reset function, the micro-switches can be reset to the normal operating conditions manually after the device has tripped:

1. Push the signal pin into the device.
 - » The micro-switches have been reset.

8 Maintenance and inspection

Maintenance

The product is maintenance-free.

Inspection

Depending on the conditions of use of the device and the national regulations in the respective country of use, the transformer manufacturers can specify different inspection intervals.

- Observe the inspection intervals defined in CIGRE Publication No. 445 "Guide for Transformer Maintenance" or the inspection intervals specified by the transformer manufacturer.

The following checks are necessary for each transformer inspection:

- Visual inspection for leaks, corrosion and damage
- Check the function of the switches, see [▶ Section 6.3, Page 29]

In addition, the following checks are necessary during every second transformer inspection:

- Visual inspection for leaks, corrosion and damage under the protective cover. To do so, remove the protective cover, see section Mounting the device [▶ Section 5.2, Page 23].
- Visual inspection of the compression springs
- Visual inspection of the flange
- Visual inspection of the switches

In the event of questions or irregularities, contact the Technical Service department:

CEDASPE S.r.l

Via Colombara 1
20098 S. Giuliano Milanese (MI)
Italy
Tel.: +39 029 820 4411
Internet: www.reinhausen.com

9 Fault elimination

This chapter describes how to eliminate simple operating faults.

9.1 Testing the tripping circuit and reason for tripping

If the signal pin is in the Operation position, this means that the pressure relief device has not tripped. If a micro-switch has nonetheless issued a signal, the fault may lie in the tripping circuit. If this is the case, check whether the signals in the tripping circuit are transmitted reliably.

If the signal pin is in the Alarm position, this means that the pressure relief device has tripped. If this is the case, clarify the following questions and, if necessary, contact the manufacturer of the transformer/on-load tap-changer so that further measures can be taken:

- Has oil leaked from the pressure relief device?
 - Was the transformer exposed to mechanical stress?
 - What was the load of the transformer at the instant of tripping?
 - Was the on-load tap-changer in operation immediately before or during tripping?
 - Were other protective devices activated at the time of tripping?
 - Were switching operations in the network being carried out at the time of tripping?
 - Were overvoltages registered at the time of tripping?
 - How high is the static pressure on the pressure relief device (difference in height between the oil level in the conservator and in the pressure relief device)?
- Only once all potential errors have been eliminated should you push the signal pin back into the device, otherwise the valve cannot be tripped again.

10 Disposal

Observe the national disposal regulations in the country of use.

10.1 SVHC information in accordance with the REACH regulation

This product complies with the provisions of European Regulation 1907/2006/EC dated December 18, 2006 on the Registration, Evaluation, Authorization and Restriction of Chemicals (REACH).

The following components of the product contain > 0.1% [w/w] of the SVHC substance lead (CAS no. 7439-92-1):

- Aluminum alloy
- Brass alloy
- Machining steel

11 Technical data

Basic materials	
Mounting flange, protective cover	Cast aluminum, 2-layer paint system (epoxy and polyurethane), standard RAL 7031 or 7033 (other colors on request); offshore versions on request
Valve plate	Cast aluminum and brass
Springs	Spring steel

Operating conditions	
Location of use	Indoors and outdoors; tropic-proof
Ambient air temperature	-50 °C...+80 °C
Operating temperature	-40 °C...+115 °C
Insulating fluid temperature	-25 °C...+105 °C (up to +115 °C in transformer overload operation) Temperature ranges for alternative insulating fluids on request
Storage temperature	-40 °C...+80 °C
Degree of protection	IP 65 in accordance with IEC 60 529
Operating pressure	0.3...1.5 bar (30 kPa...150 kPa), see table below

Operating pressure ¹⁾ [bar]	Min. operating pressure ²⁾ [bar]	Max. operating pressure ³⁾ [bar]	Transformer operating pressure ⁴⁾ [bar]	Min. closing pressure [bar]	Leakage test pressure ⁵⁾ [bar]
0.3	0.300	0.375	0.2	0.085	0.15 below the min. operating pressure
0.4	0.380	0.460	0.3	0.15	
0.5	0.475	0.575	0.38	0.17	
0.6	0.570	0.660	0.5	0.2	
0.7	0.660	0.770	0.56	0.3	
0.8	0.760	0.864	0.66	0.35	
0.9	0.850	0.970	0.75	0.40	
1.1	1.100	1.180	0.90	0.55	
1.3	1.300	1.400	1.00	0.65	
1.5	1.500	1.600	1.30	0.80	

¹⁾ Nominal pressure of the device is set at the factory.

²⁾ and ³⁾ Minimum and maximum operating pressure at which the device must trip. The values specified in the table are absolute values.

⁴⁾ Maximum permanent operating pressure of the transformer at which no insulating fluid may escape from the device.

⁵⁾ Minimum pressure to be set at the start of the leakage test.

Specifications

Nominal width, flange version	DN80: Flange with 4 drill holes
Weight	Approx. 7 kg

Micro-switches

Change-over contact Micro K (Crouzet) ST	Quantity	1...4 (depending on device version)
	Contact material	Nickel-plated silver
	Min. and max. current	1...10 A
	Breaking capacity DC	250 V...5 A
	Breaking capacity AC	125 V...1 A

Micro-switches

Low current change-over contact Micro K (Crouzet) BC	Quantity	1...4 (depending on device version)
	Contact material	Gold alloy
	Min. and max. current	1...100 mA
	Min. and max. voltage	4...30 V

Connection

Cable inlet gland	M25 x 1.5
Connection terminals switch	M3 screw
Protective conductor	M5 screw

Insulating fluid


- Unused insulating oils derived from petroleum products¹⁾ in accordance with IEC 60296 and ASTM D3487 (equivalent standards on request)
- Unused insulating oils derived from other virgin hydrocarbons in accordance with IEC 60296, or blends of these oils with petroleum products¹⁾ in accordance with IEC 60296, ASTM D3487 or equivalent standards on request
- Alternative insulating fluids, such as natural and synthetic esters or silicone oils, on request

¹⁾ Gas-to-liquid oils (GTL oils) are understood in this context as petroleum products

12 Drawings

The product may have been altered since this document was published.

CEASPE S.r.l. COPYRIGHT RESERVED
 THE REPRODUCTION, DISTRIBUTION AND UTILIZATION OF THIS DOCUMENT AS WELL AS THE COMMUNICATION OF ITS CONTENTS TO OTHERS WITHOUT EXPRESS AUTHORIZATION IS PROHIBITED. OFFENDERS WILL BE HELD LIABLE FOR THE PAYMENT OF DAMAGES. ALL RIGHTS RESERVED IN THE EVENT OF THE GRANT OF A PATENT, UTILITY MODEL OR DESIGN.

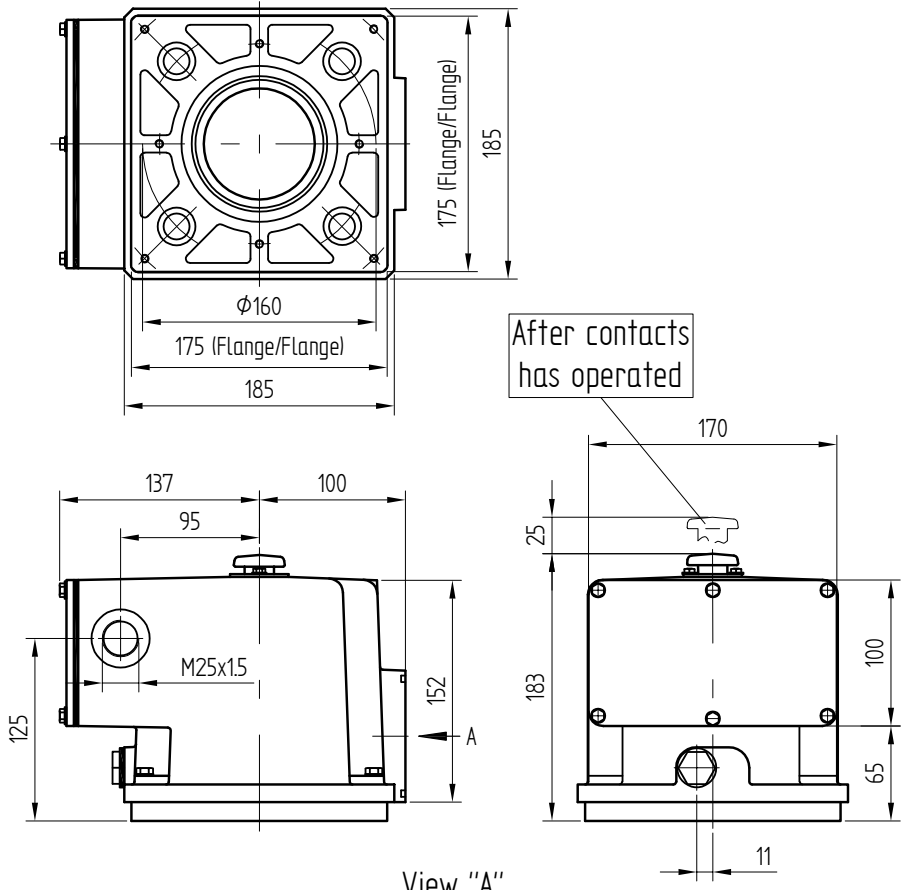

After contacts has operated

DATE	NAME	DOCUMENT NO.
25/10/23	Castellini S.	6436 - CATALOGUE
25/10/23	Tripepi R.	CHANGE NO.
25/10/23	Giorgi A.	00
SCALE	1:2	

DIMENSION
 IN mm
 EXCEPT AS
 NOTED



PRESSURE RELIEF DEVICE
 VST-2 080

SERIAL NUMBER	
MATERIAL NUMBER	SHEET
	1 / 1

Glossary

Ambient air temperature

Permissible temperature of the air in the surroundings of the equipment in operation on which the device is installed.

Insulating fluid temperature

Permissible temperature of the insulating fluid in the product or directly on the product.

Operating temperature

Permissible temperature in the immediate surroundings of the device during operation taking ambient influences, for example due to the equipment and installation location, into consideration.

Storage temperature

Permissible temperature for storing the device in an unmounted state or in a mounted state so long as the device is not in operation.

Maschinenfabrik Reinhausen GmbH

Falkensteinstrasse 8

93059 Regensburg

Germany

+49 941 4090-0

info@reinhausen.com

reinhausen.com

Please note:

The data in our publications may differ from the data of the devices delivered. We reserve the right to make changes without notice.

10707531/00 EN - Pressure relief device Operating instructions - 12/23

Maschinenfabrik Reinhausen GmbH 2023



THE POWER BEHIND POWER.