

Operating instructions

CEDASPE® CPR3. Protective relay

10309454/00 EN



© All rights reserved by Maschinenfabrik Reinhausen

Dissemination and reproduction of this document and use and disclosure of its content are strictly prohibited unless expressly permitted.

Infringements will result in liability for compensation. All rights reserved in the event of the granting of patents, utility models or designs.

The product may have been altered since this document was published.

We reserve the right to change the technical data, design and scope of supply.

Generally the information provided and agreements made when processing the individual quotations and orders are binding.

The original operating instructions were written in German.

Table of contents

1	Introduction	5
1.1	Manufacturer	5
1.2	Safekeeping	5
1.3	Notation conventions	5
1.3.1	Hazard communication system	5
1.3.2	Information system	7
1.3.3	Instruction system	7
1.3.4	Typographic conventions	8
2	Security	9
2.1	Intended use	9
2.2	Fundamental safety instructions	10
2.3	Personnel qualification	12
2.4	Personal protective equipment	13
3	Product description	14
3.1	Scope of delivery	14
3.2	Function description	14
3.3	Design	16
4	Packaging, transport and storage	19
4.1	Purpose	19
4.2	Suitability, structure and production	19
4.3	Markings	19
4.4	Transportation, receipt and handling of shipments	20
4.5	Storage of shipments	21
5	Mounting	22
5.1	Checking the pipe flanges	22
5.2	Gasket requirements	23
5.3	Preparation for mounting	24
5.4	Fastening the protective relay to the pipe	26
5.5	Electrical connection	28
5.5.1	Cable recommendation	28
5.5.2	Electrically connecting the reed switches	28

6	Commissioning	31
6.1	Filling with oil and performing the venting test	31
6.2	Leak test.....	32
6.3	Testing the function of the reed-type switches.....	32
6.3.1	Gas accumulation in the device	32
7	Operation.....	34
7.1	Warning contact signals	34
8	Maintenance and inspection	35
8.1	Draining the insulation fluid	35
9	Disposal	36
9.1	SVHC information in accordance with the REACH regulation	36
10	Technical data.....	37
11	Drawings.....	39
11.1	4919	40
	Glossary	41

1 Introduction

This technical file contains detailed descriptions on the safe and proper installation, connection, commissioning and monitoring of the product.

This technical document is intended solely for specially trained and authorized personnel.

1.1 Manufacturer

CEDASPE S.r.l.
Via Colombara 1
20098 S. Giuliano Milanese (MI)
Italy

Tel.: +39 029 820 4411
Internet: www.reinhausen.com

Further information on the product and copies of this technical file are available from this address if required.

1.2 Safekeeping

Keep this technical file and all supporting documents ready at hand and accessible for future use at all times.

1.3 Notation conventions

This section contains an overview of the symbols and textual emphasis used.

1.3.1 Hazard communication system

Warnings in this technical file are displayed as follows.

1.3.1.1 Warning relating to section

Warnings relating to sections refer to entire chapters or sections, sub-sections or several paragraphs within this technical document. Warnings relating to sections have the following format:

⚠️ WARNING



Type of danger!
Source of the danger and its consequences.

- > Action
- > Action

1.3.1.2 Embedded warning information

Embedded warnings refer to a particular part within a section. These warnings apply to smaller units of information than the warnings relating to sections. Embedded warnings use the following format:

⚠️ DANGER! Instruction for avoiding a dangerous situation.

1.3.1.3 Signal words

Depending on the product, the following signal words are used:

Signal word	Meaning
DANGER	Indicates a hazardous situation which, if not avoided, will result in death or serious injury.
WARNING	Indicates a hazardous situation which, if not avoided, could result in death or serious injury.
CAUTION	Indicates a hazardous situation which, if not avoided, could result in minor or moderate injury.
NOTICE	Indicates measures to be taken to prevent damage to property.

Table 1: Signal words in warning notices

1.3.2 Information system

Information is designed to simplify and improve understanding of particular procedures. In this technical file it is laid out as follows:



Important information.

1.3.3 Instruction system

This technical file contains single-step and multi-step instructions.

Single-step instructions

Instructions which consist of only a single process step are structured as follows:

Aim of action

✓ Requirements (optional).

1. Step 1 of 1.

» Result of step (optional).

» Result of action (optional).

Multi-step instructions

Instructions which consist of several process steps are structured as follows:

Aim of action

✓ Requirements (optional).

1. Step 1.

» Result of step (optional).

2. Step 2.

» Result of step (optional).

» Result of action (optional).

1.3.4 Typographic conventions

Typographic convention	Purpose	Example
UPPERCASE	Operating controls, switches	ON/OFF
[Brackets]	PC keyboard	[Ctrl] + [Alt]
Bold	Software operating controls	Press Continue button
...>...>...	Menu paths	Parameter > Control parameter
<i>Italics</i>	System messages, error messages, signals	<i>Function monitoring alarm triggered</i>
[► Number of pages]	Cross reference	[► Page 41].
Dotted underscore	Glossary entry, abbreviations, definitions, etc.	<u>Glossary entry</u>

Table 2: Typographic conventions used in this technical file

2 Security

Read this technical file through carefully to familiarize yourself with the product. This technical file is a part of the product.

- Read and observe the safety instructions provided in this chapter in particular.
- Observe the warnings in this technical file to avoid function-related dangers.

The product is manufactured based on state-of-the-art technology. Nevertheless, danger to life and limb for the user or impairment of the product and other material assets may arise in the event of improper use.

2.1 Intended use

The device is a protective device designed for use on oil-filled power transformers with a rubber bag in the oil conservator.

The product is designed solely for use in stationary large-scale systems.

If used as intended and in compliance with the requirements and conditions specified in this technical file as well as the warning notices in this technical file and attached to the product, then the product does not present any danger to people, property or the environment. This applies throughout the service life of the product, from delivery, installation and operation to removal and disposal.

The following is considered intended use:

- Only use the product for oil-filled power transformers with a rubber bag in the oil conservator.
- Operate the product in accordance with this technical documentation, the agreed-upon delivery conditions and the technical data.
- Ensure that all necessary work is performed by qualified personnel only.
- Use the equipment and special tools supplied solely for the intended purpose and in accordance with the specifications of this technical file.

2.2 Fundamental safety instructions

To prevent accidents, malfunctions and damage as well as unacceptable adverse effects on the environment, those responsible for transport, installation, operation, maintenance and disposal of the product or parts of the product must ensure the following:

Personal protective equipment

Loosely worn or unsuitable clothing increases the danger of becoming trapped or caught up in rotating parts and the danger of getting caught on protruding parts. This results in danger to life and limb.

- All necessary devices and personal protective equipment required for the specific task, such as a hard hat, safety footwear, etc. must be worn. Observe the "Personal protective equipment" [► Section 2.4, Page 13] section.
- Never wear damaged personal protective equipment.
- Never wear rings, necklaces or other jewelry.
- If you have long hair, wear a hairnet.

Work area

Untidy and poorly lit work areas can lead to accidents.

- Keep the work area clean and tidy.
- Make sure that the work area is well lit.
- Observe the applicable laws for accident prevention in the relevant country.

Explosion protection

Highly flammable or explosive gases, vapors and dusts can cause serious explosions and fire.

- Do not install or operate the product in areas where a risk of explosion is present.

Safety markings

Warning signs and safety information plates are safety markings on the product. They are an important aspect of the safety concept. Safety markings are depicted and described in the chapter "Product description".

- Observe all safety markings on the product.
- Make sure all safety markings on the product remain intact and legible.
- Replace safety markings that are damaged or missing.

Ambient conditions

To ensure reliable and safe operation, the product must only be operated under the ambient conditions specified in the technical data.

- Observe the specified operating conditions and requirements for the installation location.

Modifications and conversions

Unauthorized or inappropriate changes to the product may lead to personal injury, material damage and operational faults.

- Only modify the product after consultation with Maschinenfabrik Reinhausen GmbH.

Spare parts

Spare parts not approved by Maschinenfabrik Reinhausen GmbH may lead to physical injury, damage to the product and malfunctions.

- Only use spare parts that have been approved by Maschinenfabrik Reinhausen GmbH.
- Contact Maschinenfabrik Reinhausen GmbH.

Working during operation

You must only operate the product when it is in a sound operational condition. Otherwise it poses a danger to life and limb.

- Regularly check the operational reliability of safety equipment.
- Perform the inspection tasks described in this technical document regularly.

2.3 Personnel qualification

The person responsible for assembly, commissioning, operation and inspection must ensure that personnel are sufficiently qualified.

Electrically skilled person

The electrically skilled person has a technical qualification and therefore has the required knowledge and experience, and is also conversant with the applicable standards and regulations. The electrically skilled person is also proficient in the following:

- Can identify potential dangers independently and is able to avoid them.
- Is able to perform work on electrical systems.
- Is specially trained for the working environment in which (s)he works.
- Must satisfy the requirements of the applicable statutory regulations for accident prevention.

Electrically trained persons

An electrically trained person receives instruction and guidance from an electrically skilled person in relation to the tasks undertaken and the potential dangers in the event of inappropriate handling as well as the protective devices and safety measures. The electrically trained person works exclusively under the guidance and supervision of an electrically skilled person.

Operator

The operator uses and operates the product in line with this technical file. The operating company provides the operator with instruction and training on the specific tasks and the associated dangers arising from improper handling.

Technical Service

We strongly recommend having repairs and retrofitting carried out by our Technical Service department. This ensures that all work is performed correctly. If a repair is not carried out by our Technical Service department, please ensure that the personnel who carry out the maintenance are trained and authorized by CEDASPE S.r.l. to carry out the work.

CEDASPE S.r.l

Via Colombara 1

20098 S. Giuliano Milanese (MI)

Italy

Tel.: +39 029 820 4411

Internet: www.reinhausen.com

2.4 Personal protective equipment

Personal protective equipment must be worn during work to minimize risks to health.

- Always wear the personal protective equipment required for the job at hand.
- Never wear damaged personal protective equipment.
- Observe information about personal protective equipment provided in the work area.

Protective clothing	Close-fitting work clothing with a low tearing strength, with tight sleeves and with no protruding parts. It mainly serves to protect the wearer against being caught by moving machine parts.
Safety shoes	To protect against falling heavy objects and slipping on slippery surfaces.
Safety glasses	To protect the eyes from flying parts and splashing liquids.
Visor	To protect the face from flying parts and splashing liquids or other dangerous substances.
Hard hat	To protect against falling and flying parts and materials.
Hearing protection	To protect against hearing damage.
Protective gloves	To protect against mechanical, thermal and electrical hazards.

Table 3: Personal protective equipment

3 Product description

3.1 Scope of delivery

The product is delivered as follows:

- Protective relay
- Plastic bag with fastening materials for connection cables

3.2 Function description

The device is a protective device for on-load tap-changers, reactors and oil-filled transformers with a rubber bag in the oil conservator.

The device is designed to be installed in a flanged pipe on the upper side of the conservator. Alternatively, the device can be installed in an L-shaped flanged pipe attached to one of the two closing side plates of the conservator. Normally, this pipe is attached to the side of the conservator on which the oil level indicator is also mounted.

If the device trips, a signal is sent via up to 2 reed-type switches (max. 1 normally open contact or max. 2 change-over contacts). The reed-type switches are connected to the electrical controller and the monitoring circuit of the transformer.

The device detects the following:

Gas accumulation in the device (warning contact, ALARM)

The gas migrates upwards - for example, from a leaky rubber bag - in the insulating liquid, collects in the gas chamber of the device and displaces the insulating fluid. As the fluid level drops, the float gauge lowers, activating the reed-type switch and triggering an electrical signal.

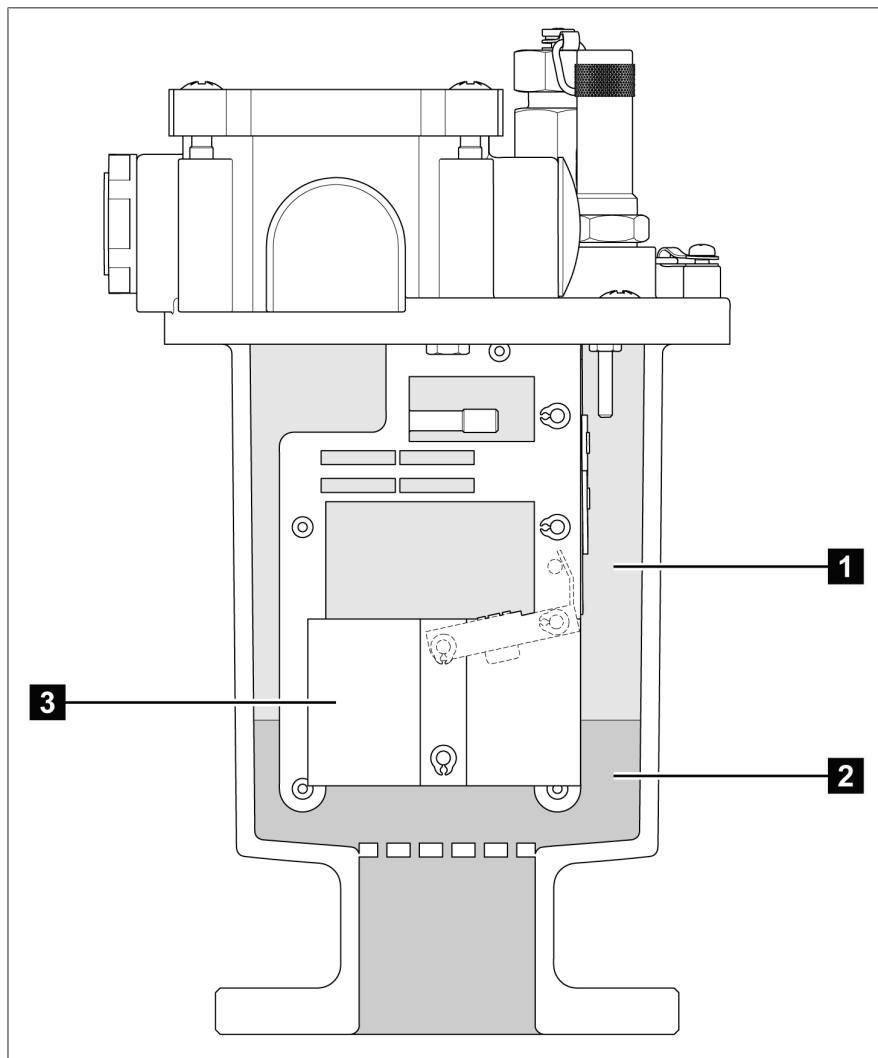


Figure 1: Gas accumulation in the device

1	Gas	2	Insulating fluid
3	Float gauge		

3.3 Design

The device is suitable for installation in the nominal DN25 pipe diameter.

The connection flange on the device has 4 drill holes.

The device can be equipped with up to 2 reed-type switches (max. 1 normally open contact or max. 2 change-over contacts). The reed-type switches are connected electrically via the terminal box.

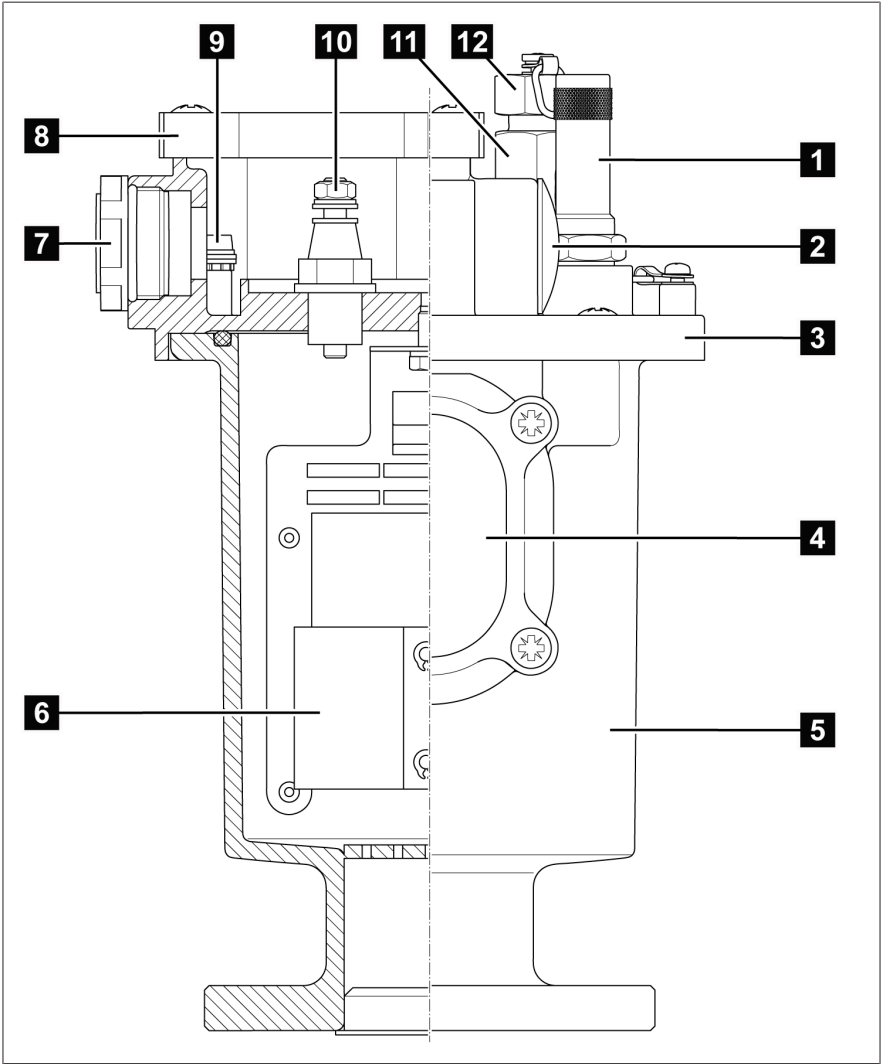


Figure 2: Design

1	Test button cover	2	Dummy plug
3	Cover	4	Inspection window
5	Housing	6	Float gauge
7	M20 x 1.5/M25 x 1.5 adapter	8	Terminal box cover
9	Grounding screw	10	Terminals
11	Gas extraction valve	12	Gas extraction valve protective cap

4 Packaging, transport and storage

4.1 Purpose

The packaging is designed to protect the packaged product during transport, loading, unloading and during periods of storage in such a way that no detrimental changes occur. The packaging must protect the goods against permitted transport stresses such as vibration and knocks.

The packaging also prevents the packaged goods from moving impermissibly within the packaging.

4.2 Suitability, structure and production

The goods are packaged in a sturdy cardboard box. This ensures that the shipment is held securely in the intended transport position.

Inlays inside the box stabilize the goods, preventing impermissible changes of position, and protect them from vibration.

4.3 Markings

The packaging bears a signature with instructions for safe transport and correct storage. The following symbols apply to the shipment of non-hazardous goods. Adherence to these symbols is mandatory.




 Protect against moisture	 Top	 Fragile
---	--	--

Table 4: Shipping pictograms

4.4 Transportation, receipt and handling of shipments

In addition to vibrations, jolts must also be expected during transportation. In order to prevent possible damage, avoid dropping, tipping, knocking over and colliding with the product.

If the packaging tips over or falls, damage is to be expected regardless of the weight.

Every delivered shipment must be checked for the following by the recipient before acceptance (acknowledgment of receipt):

- Completeness based on the delivery slip
- External damage of any type.

The checks must take place after unloading when the cartons or transport container can be accessed from all sides.

Visible damage

If external transport damage is found upon receipt of the shipment, proceed as follows:

- Immediately record the transport damage found in the shipping documents and have this countersigned by the carrier.
- In the event of severe damage, total loss or high damage costs, immediately notify CEDASPE S.r.l and the relevant insurance company.
- After identifying damage, do not modify the condition of the shipment further and retain the packaging material until an inspection decision has been made by the transport company or the insurance company.
- Record the details of the damage immediately on site together with the carrier involved. This is essential for any claim for damages.
- If possible, photograph damage to packaging and packaged goods. This also applies to signs of corrosion on the packaged goods due to moisture inside the packaging (rain, snow, condensation).
- Be absolutely sure to also check the sealed packaging.

Hidden damage

When damage is not determined until unpacking after receipt of the shipment (hidden damage), proceed as follows:

- Make the party responsible for the damage liable as soon as possible by telephone and in writing, and prepare a damage report.
- Observe the time periods applicable to such actions in the respective country. Inquire about these in good time.

With hidden damage, it is very hard to make the transportation company (or other responsible party) liable. Any insurance claims for such damage can only be successful if relevant provisions are expressly included in the insurance terms and conditions.

4.5 Storage of shipments

When selecting and setting up the storage location, ensure the following:

- Store the product and accessories in the original packaging until installation.
- Protect stored goods against moisture (rain, flooding, water from melting snow and ice), dirt, pests such as rats, mice, termites etc. and against unauthorized access.
- Store crates and boxes on pallets, timber beams or planks as protection against ground moisture and for improved ventilation.
- Ensure that the foundation has sufficient load-bearing capacity.
- Keep entrance paths clear.
- Check the stored goods at regular intervals. Also take appropriate action after storms, heavy rain or snow etc.

5 Mounting

DANGER



Electric shock!

Danger of death due to electrical voltage when assembling/dis-assembling the device.

- Switch off transformer on high-voltage side and low-voltage side.
- Lock transformer to prevent unintentional restart.
- Make sure that everything is de-energized.
- Visibly connect all transformer terminals to ground (grounding leads, grounding disconnectors) and short circuit them.
- Cover or cordon off adjacent energized parts.

This chapter describes the installation of the device as well as the electrical connection of the reed-type switches.

5.1 Checking the pipe flanges

The pipe flanges must be flush and clean to allow the device to be positioned with the least possible stress.

NOTICE! A residual distance between the flanges caused by a deviation in evenness can cause damage to the flanges. Even slight unevenness can cause the flange of the device to be curved too much, leading to cracks in the flange caused by the resulting transverse stress.

Therefore, check the following:

- Pipe flanges
 - Flush and even
 - Evenness deviation ≤ 0.2 mm

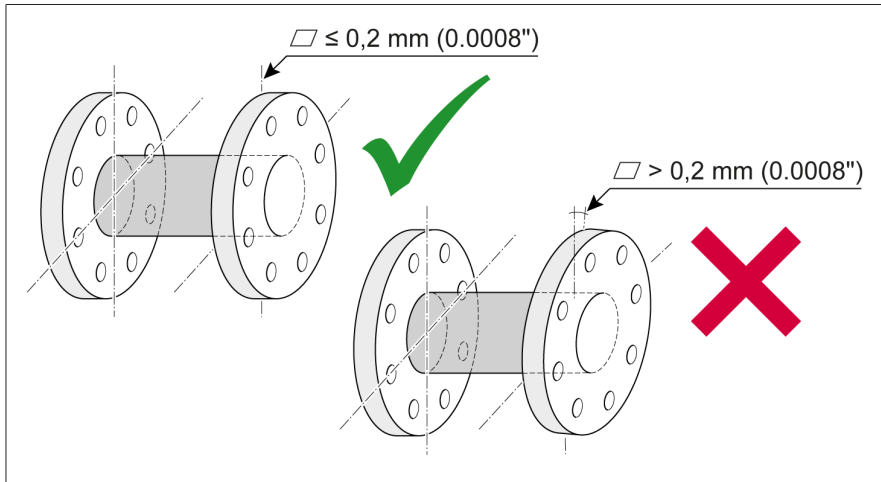


Figure 3: Flanges

- Pipe flange sealing surfaces
 - Clean and undamaged
 - Without any damage along the radial surface such as scratches, dents or points of impact
 - The surface quality of the sealing surface must be suitable for the gasket being used
- Installation material (screws, nuts, washers)
 - Clean and undamaged, particularly the threads and contact surfaces

5.2 Gasket requirements

When selecting the gaskets, observe the following notices:

- Ensure that the design of the gasket and, if applicable, the sealing groove are state-of-the-art.
- Use new and clean gaskets.
- Use O-rings or flat gaskets in accordance with the following mounting description.
- Never use paper gaskets.
- Gasket material:
 - The material must be chemically resistant to the insulating fluid used to prevent later leaks due to chemical degradation.

- The gasket material must be suitable for use at the intended ambient temperatures and operating temperatures.
- The gasket material must be suitable for the relative humidity prevalent on site.
- When mounted, x gaskets must fill a maximum of 80% of the sealing groove. The remaining 20% is required as expansion space.

5.3 Preparation for mounting

1. The protective relay is intended for use in a vertical operating position. An inclination of up to 5° to the vertical axis must be permitted.

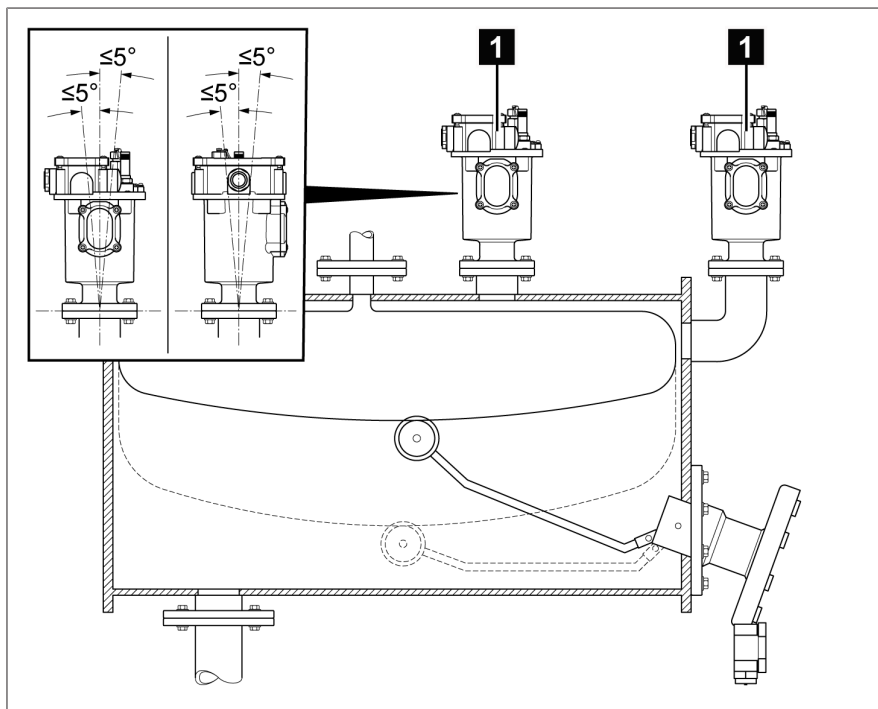


Figure 4: Permissible inclination of the protective relay

1	Protective relay mounting options		
---	-----------------------------------	--	--

2. Removing the plastic cover on the flange on the protective relay

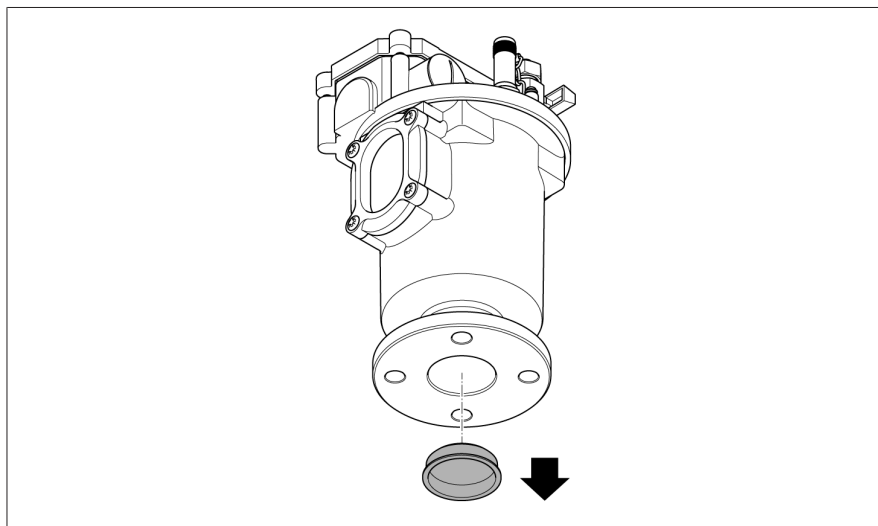


Figure 5: Removing the plastic cover

3. **NOTICE!** Malfunction! The plug on the test button must be removed to ensure the correct functioning of the device. Loosen and remove the test button cover by hand, remove the plug on the test button and fasten the cover back onto the test button.

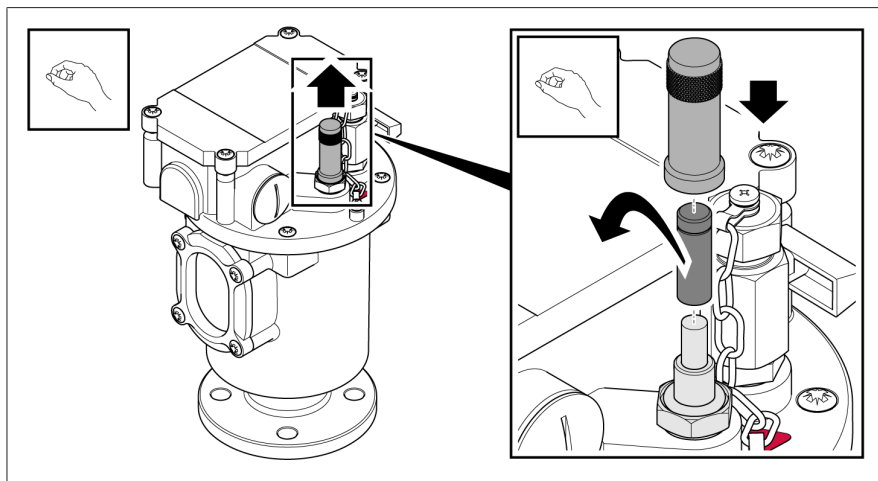


Figure 6: Removing the plug in the test button

5.4 Fastening the protective relay to the pipe

The device is designed to be installed in a flanged pipe on the upper side of the conservator. Alternatively, the device can be installed in an L-shaped flanged pipe attached to one of the two closing side plates of the conservator. Normally, this pipe is attached to the side of the conservator on which the oil level indicator is also mounted.

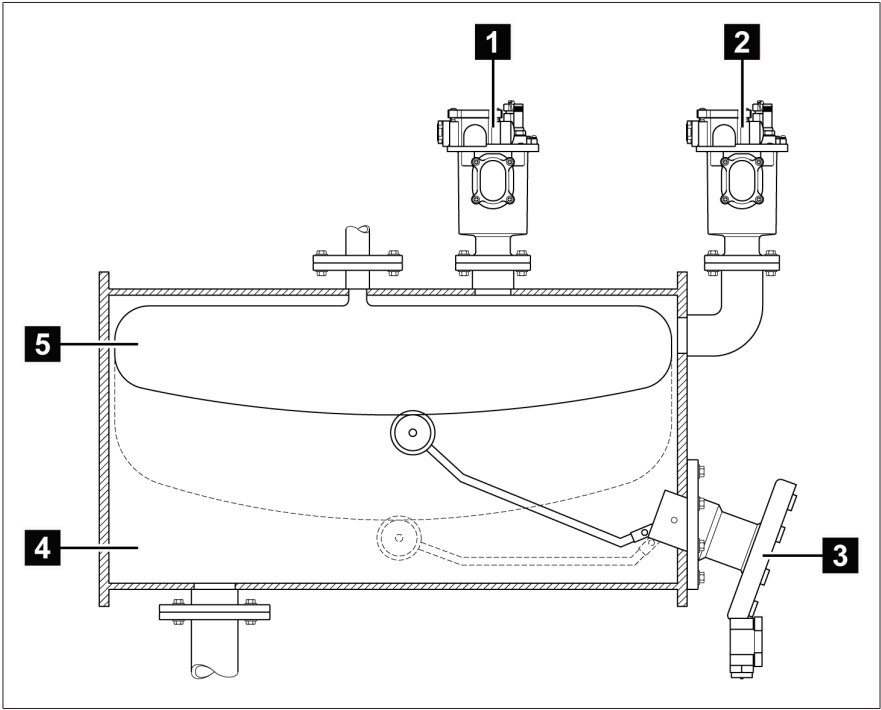


Figure 7: Fastening the device to the pipe

1	Mounting option 1: Installation in a flanged pipe on the upper side of the conservator	2	Mounting option 2: Installation in an L-shaped flanged pipe on a closing side plate of the conservator
3	Oil level indicator (optional)	4	Conservator
5	Rubber bag		

1. Ensure that there is no insulating fluid in the pipe.
2. Place a suitable flat gasket between the device flange and pipe flange.
3. Affix the protective relay using suitable screws (4 x M10 hexagon screws), washers and nuts. Only tighten screws by hand.
4. Tighten the screws with 10% of the target tightening torque and ensure that there are no gaps between the flanges. If there is a gap, repair the affected pipe flanges or, if necessary, detach and re-weld them so that there is no longer a gap.
5. Tighten the screws crosswise with 30% of the target tightening torque.
6. Tighten the screws crosswise with 60% of the target tightening torque.
7. **NOTICE!** Damage to the flanges due to a tightening torque that is too high. Use a torque wrench. Tighten the screws crosswise with 100% of the target tightening torque and continue to retighten the screws with 100% of the target tightening torque until the screws can no longer be turned further.

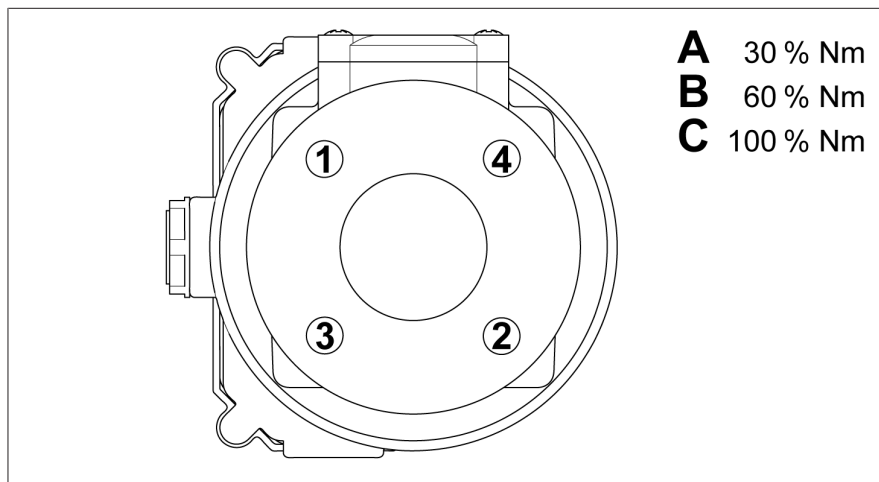


Figure 8: Tightening the screws crosswise

5.5 Electrical connection

⚠ DANGER



Electric shock!

Risk of fatal injury due to electrical voltage when connecting the device.

- Ensure that all cables are free of voltage during connection work.

5.5.1 Cable recommendation

Please note the following recommendation when wiring the device:

- To make the connection, you need suitable ring cable lugs and cable glands that are not included in the scope of delivery.
- The cables used must be flame-resistant in accordance with IEC 60332-1-2 or UL 2556 VW-1.
- If both low voltage and extra-low voltage are connected in the device, it must be ensured that the circuits for extra-low voltage and for low voltage in the connection area and in the cable are separated from each other with double insulation.

Cable	Conductor cross-section	Connection
Signal lines	1.5...4 mm ²	M5 thread
Protective conductor	≥ all other conductors	M5 screw

Table 5: Cable recommendation

5.5.2 Electrically connecting the reed switches

The reed-type switches installed in the device are either normally open contacts or change-over contacts.

1. Unscrew the screws (4x M5 Phillips screws, crosshead screwdriver) on the terminal box and remove the cover.
2. Remove the plastic bag with fastening materials for connecting the cables from the terminal box.

3. Remove the dummy plug from the M20 x 1.5/M25 x 1.5 adapter.

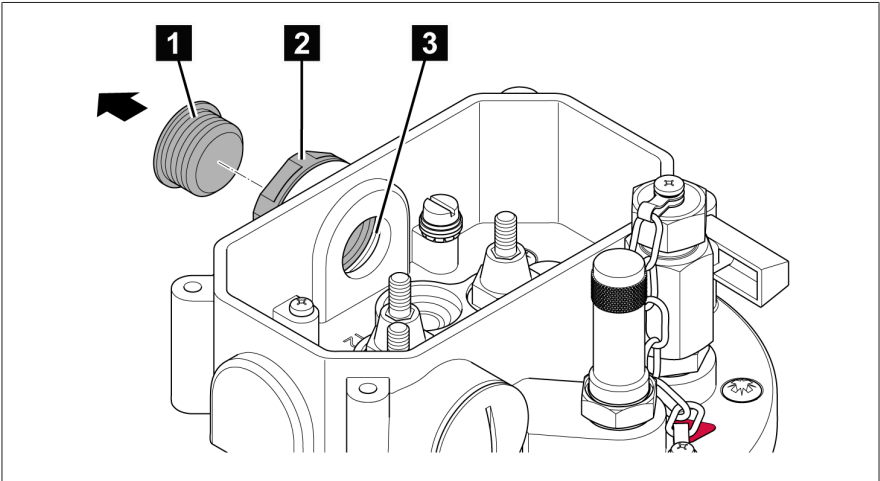


Figure 9: Dummy plug and M20/M25 adapter

1	Dummy plug	2	M20 x 1.5/M25 x 1.5 adapter
3	Housing thread: M25 x 1.5		

4. Fit an M20 cable gland in the adapter or remove the adapter and fasten an M25 cable gland (wrench size 28) directly in the housing.
5. **NOTICE!** To ensure the IP degree of protection of the device, use a suitable cable gland with at least IP65.
6. The wiring diagram can be found on the inside of the terminal box cover.

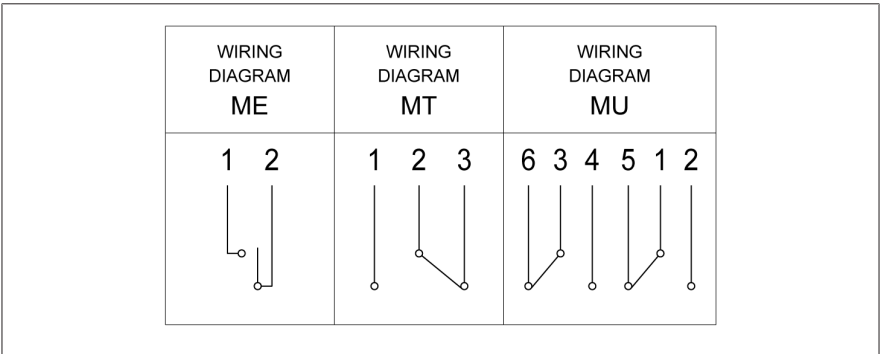


Figure 10: Wiring diagrams

- 7. **NOTICE!** To prevent damage, observe the specified tightening torques.
- 8. Guide the cable through the cable gland and connect the ring cable lugs to the terminals using the fastening materials in the plastic bag as follows.

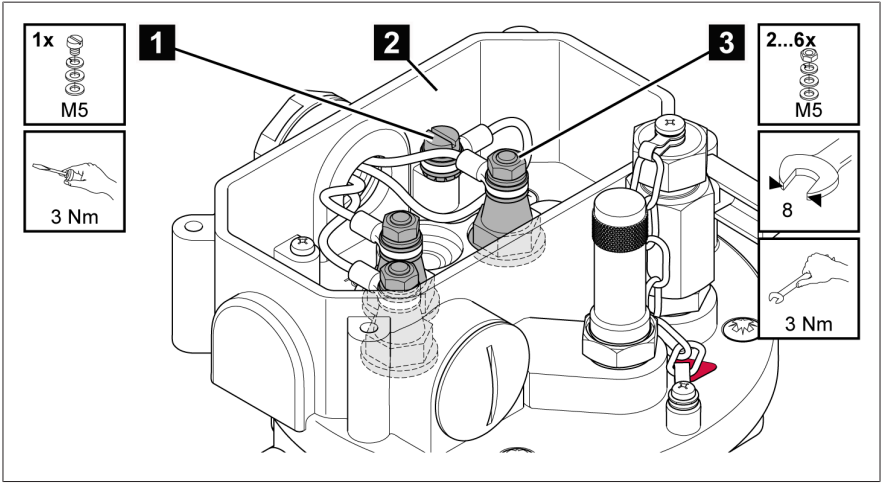


Figure 11: Terminal box

1	M5 grounding screw	2	Terminal box
3	Reed-type switch connections, 2... 6 x M5		

- 9. Place the ring cable lug between two washers to connect the reed-type switches.
- 10. Fit a spring washer on the upper washer and fasten the cable to the clamp by tightening a nut.
- 11. Ground the device via a grounding cable with ring cable lug. To do so, loosen the grounding screw.
- 12. Place the ring cable lug on the grounding screw between two washers.
- 13. Fit a spring washer on the upper washer and tighten the grounding screw.
- 14. Tighten the cable gland.
- 15. Position the cover on the terminal box and affix using the 4 screws (crosshead screwdriver).

6 Commissioning

Prior to commissioning the transformer, perform the following checks. If anything is unclear regarding the checks or troubleshooting, please contact CEDASPE S.r.l. [► Section 1.1, Page 5].

6.1 Filling with oil and performing the venting test

▲ WARNING



Danger of explosion and danger of poisoning!

Explosive gases in the protective relay can deflagrate or explode and result in severe injury or death. Inhaling the gases released can lead to poisoning or suffocation.

- Ensure that there are no ignition sources such as open flames, hot surfaces or sparks (e.g. caused by the build-up of static charge, electrical devices) in the immediate surroundings and that none occur.
 - Do not inhale any gas released.
-
1. When filling the conservator with oil, watch through the inspection window to see if the float gauge in the protective relay rises.
 2. As soon as the maximum oil level is reached in the conservator, vent the protective relay. To do so, remove the protective cap from the gas extraction valve (wrench size 17).
 3. Turn the lever of the gas extraction valve counterclockwise to vent the device.
 4. Place a cloth over the gas extraction valve to catch any insulating fluid that sprays out. As soon as insulating fluid begins to escape, turn the lever of the gas extraction valve clockwise to close the gas extraction valve.
 5. Position the protective cap on the gas extraction valve, screw on hand-tight and then tighten with maximum one half turn (wrench size 17).
 - » The device is filled with oil and vented.

6.2 Leak test

- ✓ The device is filled with insulating fluid.
- 1. Check the tightness of the flange connection.
- 2. If the connection is not tight, check the gasket and replace it if necessary.
 - » The test is complete.

6.3 Testing the function of the reed-type switches

⚠ WARNING



Danger of explosion and danger of poisoning!

Explosive gases in the protective relay can deflagrate or explode and result in severe injury or death. Inhaling the gases released can lead to poisoning or suffocation.

- > Ensure that there are no ignition sources such as open flames, hot surfaces or sparks (e.g. caused by the build-up of static charge, electrical devices) in the immediate surroundings and that none occur.
- > Do not inhale any gas released.

6.3.1 Gas accumulation in the device

The test button is used to simulate the switching of the warning contact when gas accumulates in the device.



During the test, you can watch through the inspection window to see whether the float gauge lowers. As soon as you release the test button, the float gauge rises automatically and the switches open.

- ✓ The device is filled completely with insulating fluid.
- ✓ The cover of the test button has been removed.
- ✓ The cover of the terminal box has been removed.
- ✓ Normal operating conditions have been checked and are in accordance with the wiring diagram [► Section 7.1, Page 34].

1. Connect a multimeter to the terminals of the switches in the open state.
2. Push the test button down to activate the warning contact.
 - » The multimeter receives a signal.
3. Position the cover on the test button and screw on hand-tight with maximum one half turn.
 - » The test is complete.

7 Operation

7.1 Warning contact signals

Normal operating conditions	Description of warning contact (ALARM)	Note
<div> WIRING DIAGRAM ME </div>	ALARM – Gas accumulation in the device: switches 1-2 closed.	Check the insulating fluid level via the inspection window. Gas can be extracted via the gas extraction valve.
<div> WIRING DIAGRAM MT </div>	ALARM – Gas accumulation in the device: switches 1-2 closed.	Check the insulating fluid level via the inspection window. Gas can be extracted via the gas extraction valve.
<div> WIRING DIAGRAM MU </div>	ALARM – Gas accumulation in the device: switches 1-2 and 3-4 closed.	Check the insulating fluid level via the inspection window. Gas can be extracted via the gas extraction valve.

Table 6: Warning contact signals

8 Maintenance and inspection

Maintenance

The device is maintenance-free.

Inspection

Depending on the conditions of use of the device and the national regulations in the respective country of use, the transformer manufacturers can specify different inspection intervals.

- Observe the inspection intervals defined in CIGRE Publication No. 445 "Guide for Transformer Maintenance" or the inspection intervals specified by the transformer manufacturer.

During each transformer inspection, check the following:

1. Check the external condition of the device for contamination, damage (e.g. broken glass, electrical connection) and corrosion.
2. Vent the device [▶ Section 6.1, Page 31].
3. Check the tightness of the flange connection [▶ Section 6.2, Page 32].
4. Check that the device is functioning correctly [▶ Section 6.3, Page 32].

8.1 Draining the insulation fluid

If you have to drain insulating fluid from the protective relay for inspection work or maintenance work on the transformer, proceed as follows:

1. Drain insulating fluid from the conservator until the insulation fluid level is below the pipe that leads from the conservator to the protective relay.
 - » The insulating fluid has been drained from the protective relay.

9 Disposal

Observe the national disposal regulations in the country of use.

9.1 SVHC information in accordance with the REACH regulation

This product complies with the provisions of European Regulation 1907/2006/EC dated December 18, 2006 on the Registration, Evaluation, Authorization and Restriction of Chemicals (REACH).

The following components of the product contain > 0.1% [w/w] of the SVHC substance lead (CAS no. 7439-92-1):

- Aluminum alloy
- Brass alloy

10 Technical data

Basic materials	
Housing/cover	Cast aluminum, 2-layer paint system (epoxy and polyurethane), standard RAL 7031 or 7033 (other colors on request); seawater-resistant version (offshore) on request
Inspection window	Hardened glass

Specifications	
Setup	Indoors and outdoors, tropic-proof
Ambient air temperature	-50 °C...+80 °C
Storage temperature	-40 °C...+80 °C
Operating temperature	-40 °C...+115 °C
Insulating fluid temperature	-25 °C...+105 °C (up to +115 °C in transformer over-load operation) Temperature ranges for alternative insulating fluids on request
Degree of protection	IP65 in accordance with DIN EN 60529
Weight including terminal box	Approx. 2.5 kg
Nominal diameter of the pipe, flange version	DN25, flange with 4 drill holes
Gas accumulation volumes (warning contact, ALARM)	400 cm ³ ± 50 cm ³

Reed-type switches	
Number and type	Max. 1 normally open contacts or 2 change-over contacts
Nominal voltage	24...240 V DC up to 230 V AC
Max. current AC/DC	Normally open contact: 2 A Change-over contact: 1 A
Min. switched current	Normally open contact: 10 mA Change-over contact: 5 mA

Reed-type switches	
Breaking capacity DC	Normally open contact: 24...240 V DC 250 W L/R < 40 ms Change-over contact: 24...240 V DC 130 W L/R < 40 ms
Breaking capacity AC	Normally open contact: Up to 230 V AC 400 VA $\cos\varphi > 0.5$ Change-over contact: Up to 230 V AC 250 VA $\cos\varphi > 0.5$
Insulation resistance	1000 M Ω /500 V DC

Terminal box	
Cable inlet gland	M20 x 1.5/M25 x 1.5 (adapter)
Connection terminals	M5 thread
Protective conductor connection	M5 screw

Insulating fluid	
<ul style="list-style-type: none"> – Unused insulating oils derived from petroleum products¹⁾ in accordance with IEC 60296 and ASTM D3487 (equivalent standards on request) – Unused insulating oils derived from other virgin hydrocarbons in accordance with IEC 60296, or blends of these oils with petroleum products¹⁾ in accordance with IEC 60296, ASTM D3487 or equivalent standards on request – Alternative insulating fluids, such as natural and synthetic esters or silicone oils, on request 	
¹⁾ Gas-to-liquid oils (GTL oils) are understood in this context as petroleum products	

11 Drawings

DATE	NAME	DOCUMENT NO.
11/05/23	Castellini S.	4919-catalogue
CHKO	CHANGE NO.	SCALE
11/05/21	03	1:5
STAND		

DIMENSION
 IN mm
 EXCEPT AS
 NOTED






PROTECTIVE RELAY CPR3 MY.2021
 FOR RUBBER BAG CONSERVATOR


SERIAL NUMBER

MATERIAL NUMBER

SHEET
 1/1

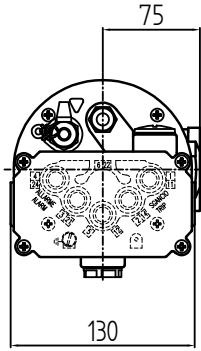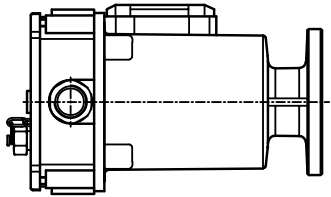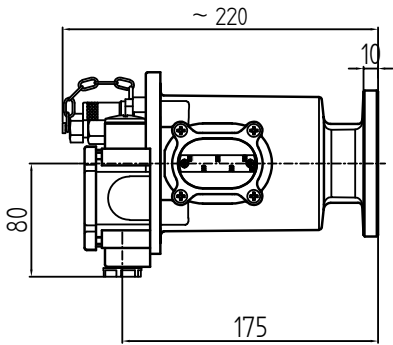

Detail of connecting flange



Glossary

Ambient air temperature

Permissible temperature of the air in the surroundings of the equipment in operation on which the device is installed.

Insulating fluid temperature

Permissible temperature of the insulating fluid in the product or directly on the product.

Operating temperature

Permissible temperature in the immediate surroundings of the device during operation taking ambient influences, for example due to the equipment and installation location, into consideration.

Storage temperature

Permissible temperature for storing the device in an unmounted state or in a mounted state so long as the device is not in operation.

Maschinenfabrik Reinhausen GmbH

Falkensteinstrasse 8

93059 Regensburg

Germany

+49 941 4090-0

info@reinhausen.com

reinhausen.com

Please note:

The data in our publications may differ from the data of the devices delivered. We reserve the right to make changes without notice.

10309454/00 EN - CEDASPE[®] CPR3 Operating instructions -
08/23

Maschinenfabrik Reinhausen GmbH 2023



THE POWER BEHIND POWER.